

INSTALLATION INSTRUCTIONS SOLO PENDANT WITH P1EE HANGING SYSTEM

These instructions cover the SOLO LUMINAIRE with the following options:

SERIES	HANGING SYSTEM	SIZE	LIGHT SOURCE	CONTROL	WIRE DIAGRAM
SL1 - SOLO	P1EE: PENDANT WITH ANGLED AIRCRAFT CABLES AND POWER CORD TO COLLECTOR THEN SINGLE CENTER STEM TO CANOPY	24"	STATIC WHITE	0-10V DIM 1% (DM1)	WIRE DIAGRAM ON PAGE 6
		36"			
		48"			
		60"			
		72"			




FIG. 1 – SL1-P1EE-MW-XX-XXX-LEDX_XXK-UNV-XXX-DM~

GENERAL NOTES:

1. PLEASE COMPLETELY READ THE INSTALL INSTRUCTIONS BEFORE STARTING INSTALLATION.
2. TURN OFF POWER TO CIRCUIT FIXTURE WHILE IT IS BEING INSTALLED.
3. INSTALL IN ACCORDANCE WITH ALL LOCAL, STATE AND NATIONAL CODES CONSULT WITH A QUALIFIED ELECTRICIAN FOR PROPER INSTALLATION.
4. CAREFULLY UNPACK ALL CONTENTS; SOME COMPONENTS MAY HAVE BEEN SHIPPED IN SEPARATE BOXES. MOST FIXTURES ARE SHIPPED PARTIALLY ASSEMBLED. SOME UNASSEMBLY MAY BE REQUIRED FOR INSTALLATION.
5. DO NOT LET THE SOLO LUMINAIRE HANG FREE UNTIL ALL THE AIRCRAFT CABLES ARE SECURED AND EVENLY TENSIONED.

OCL Architectural Lighting

Phone: 314.863.1895
Fax: 314.863.3278
www.ocl.com

Sensitivity: Internal & Restricted

Table of Contents

GENERAL INFORMATION:	3
SOLO MOUNTING:	4
WIRE DIAGRAM	6

GENERAL INFORMATION:

You will receive the following with each SOLO P1EE series pendant fixture:

1. SOLO LUMINAIRE with CORD attached. (Pre-assembled as shown in FIG. 2)
2. INSTALLATION INSTRUCTIONS (shown in FIG. 3) - Please completely read the install instructions before starting installation.
3. CANOPY AND STEM SUBASSEMBLY. (Pre-assembled as shown in FIG. 4)
4. COLLECTOR KIT as shown in FIG.5.
5. RED BAG (shown in FIG. 3) contains below following items.
 - a) FOUR (4) AIRCRAFT CABLE (shown in FIG. 6)

WARNING: Examine all components for any damage before beginning installation.

WARNING: This fixture should be installed by a licensed electrician only.

WARNING: Be careful not to scratch or damage any finished parts.




FIG. 2 - SOLO LUMINAIRE (PRE-ASSEMBLED)




FIG.3 RED BAG AND INSTALLATION INSTRUCTIONS




FIG.4 - CANOPY AND STEM SUBASSEMBLY




FIG. 5 - COLLECTOR KIT



FIG.6 AIRCRAFT CABLES

OCL Architectural Lighting

Phone: 314.863.1895

Fax: 314.863.3278

www.ocl.com

SOLO MOUNTING:

1. Loosen canopy and slide down stem by rotating the canopy 90 degrees counterclockwise. Be careful not to damage the finish of the fixture. FIG. 7.
2. Mount the assembly to the junction box (by others) as in FIG. 8. if the fixture has a safety cable, attach this to a structural member.




FIG. 7 – CANOPY DISASSEMBLY




FIG. 8 - MOUNTING PLATE INSTALLATION

3. Attach the sections of the center stem together (if applicable) at all thread coupler and make sure to build from the top down. Thread together until tight as shown in FIG. 9.
4. Insert safety cable around the collector mounting bracket then attach the collector mounting bracket to the center stem with the provided hardware. Run the safety cable through the stem to the canopy. Feed aircraft cables through the small holes in the side of the collector. Attach the collector to the collector mounting bracket with provided hardware FIG.9.




FIG. 9 – STEM INSTALLATION




FIG. 10 – COLLECTOR INSTALLATION

OCL Architectural Lighting

Phone: 314.863.1895

Fax: 314.863.3278

www.oclighting.com

SL1-P1EE-XX-INSTALLATION INSTRUCTIONS

5. Feed the wires through the assembled CENTER STEM as shown in FIG. 9.
6. If fixture is less than 55lbs and will be mounted to a STANDARD JUNCTION box, refer to "SWIVEL CANOPY ASSEMBLY UNDER 55LBS INSTALL INSTRUCTIONS" for mounting the CANOPY to the JUNCTION BOX. If fixture is over 55lbs and needs to be structurally mounted, refer to "SWIVEL CANOPY ASSEMBLY OVER 55LBS INSTALL INSTRUCTIONS". See chart below for standard fixture weights as shown in FIG.11.

SOLO FIXTURE DIAMETER (IN)	FIXTURE WEIGHT (LB)	USE CANOPY INSTALL INSTRUCTIONS:
24	20 LBS	SWIVEL CANOPY ASSEMBLY UNDER 55LBS
36	30 LBS	SWIVEL CANOPY ASSEMBLY UNDER 55LBS
48	40 LBS	SWIVEL CANOPY ASSEMBLY UNDER 55LBS
60	50 LBS	SWIVEL CANOPY ASSEMBLY UNDER 55LBS
72	60 LBS	SWIVEL CANOPY ASSEMBLY OVER 55LBS

FIG. 11 – STANDARD FIXTURE WEIGHT CHART

7. After the STEM ASSEMBLY is installed and hanging, attach the FOUR AIRCRAFT CABLES from the COLLECTOR to the GRIPLOCK at the fixture as shown in FIG.12. Each cable must be inserted at least 1.75" into the GRIPLOCK as shown in FIG. 14.




FIG. 12 – AIRCRAFT CABLE INSTALLATION




FIG. 13 – CORD INSTALLATION




FIG. 14 – GRIPLOCK INSTALLATION

8. Feed the power cord through the bottom hole in the collector as shown in FIG.13. Make wire connections inside the collector between the cord and building supply wires in the center stem. In accordance with all local, state and national codes. Make sure to attach all green grounding wires to main building ground. Place strain relief around the cord and install it in the collector as shown in FIG. 13. Install the collector cover plates to the collector with the provided hardware as shown in FIG. 15.




FIG. 15 – FIXTURE WIRING

OCL Architectural Lighting

Phone: 314.863.1895

Fax: 314.863.3278

www.oclighting.com

SL1-P1EE-XX-INSTALLATION INSTRUCTIONS

9. Make all wire connections inside the canopy in accordance with the NATIONAL ELECTRICAL CODE and all applicable LOCAL AND STATE CODES inside the JUNCTION BOX (BY OTHERS). See WIRE LABEL TABLE and WIRE DIAGRAM below as shown in FIG. 17 and 18 for wire connections.




FIG. 16 – MOUNTING PLATE
INSTALLATION TO JUNCTION BOX

SERIES	HANGING SYSTEM	SIZE	LIGHT SOURCE	LED OUTPUT	CONTROL	WIRE DIAGRAM
1. SL1(SOLO)	P1EE: PENDANT WITH ANGLED AIRCRAFT CABLES AND POWER CORD TO COLLECTOR THEN SINGLE CENTER STEM TO CANOPY	24"	STATIC WHITE	LED 1 & LED 2	0-10V DIM 1% (DM1)	WIRE DIAGRAM ON PAGE 6
		36"				
		48"				
		60"				
		72"				

WIRE DIAGRAM

WIRE LABEL TABLE		
CONTROL	WIRE COLOR	LABEL
ALL	BLACK	LINE VOLTAGE
ALL	WHITE	NEUTRAL
ALL	GREEN	GROUND
DM1	PURPLE	0-10V (+)
DM1	GREY	0-10V (-)

FIG. 17 – WIRE LABEL TABLE

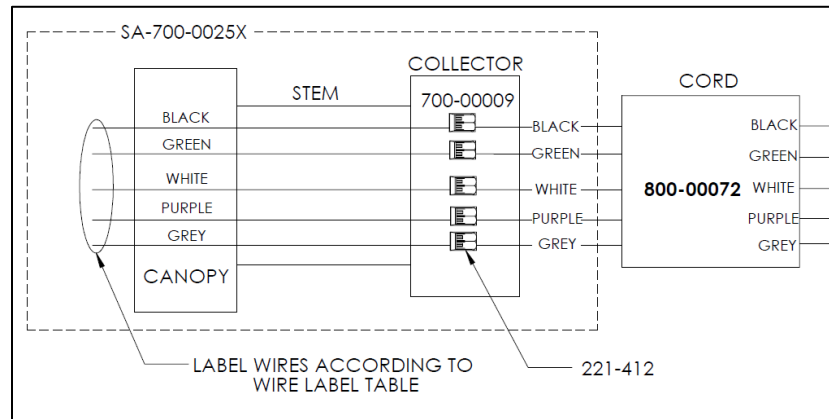


FIG. 18 – WIRE DIAGRAM

OCL Architectural Lighting

Phone: 314.863.1895

Fax: 314.863.3278

www.oclighting.com

SL1-P1EE-XX-INSTALLATION INSTRUCTIONS

10. Raise the CANOPY and tighten onto the MOUNTING BRACKET by lining the SPRING TABS up the NOTCHES in the MOUNTING BRACKET and rotating 90 degrees clockwise as shown in FIG. 19.




FIG. 19 – CANOPY INSTALLATION

11. Restore power to circuit the SOLO series pendant is connected to.
 - a. Test to see that the luminaire turns on after power is restored.
 - b. Contact OCL for any luminaire troubleshooting if a problem occurs.




FIG. 20 - COMPLETED INSTALLATION OF SOLO
PENDANT WITH P1EE HANGING SYSTEM
SL1-P1EE-MW-XXX-LEDX_XXK-UNV-XXX-DM~
(AS SHOWN)

OCL Architectural Lighting

Phone: 314.863.1895

Fax: 314.863.3278

www.ocl.com